



WESTPORT WESTON HEALTH DISTRICT

180 Bayberry Lane, Westport, CT 06880-2855

Telephone: (203) 227-9571

Non-Transferable
Approval Valid for One Year

Fee - \$30.00

Fee is Non-Refundable

APPLICATION TO INSTALL GENERATORS, FUEL STORAGE TANKS & OUTDOOR HVAC UNITS

Location: 34 Otter trail

☒ Westport ☐ Weston

Owner: Bob Baskins

Address: 34 Otter Trail

Installer: R. Piro Electric


Lic. No: 200504 EJ

Tel: (203) 650-9216

Owner/applicant accepts full responsibility for the accuracy of the information and plot plan provided.

Owner/applicant also accepts the responsibility for the relocation of the proposed generator/buried or above ground storage tank or outdoor HVAC unit should it be necessary to repair/replace the well and/or septic system within the required separating distance.

Provide a plot plan showing the proposed generator, fuel storage tank or outdoor HVAC unit. Show the existing well and the septic system.

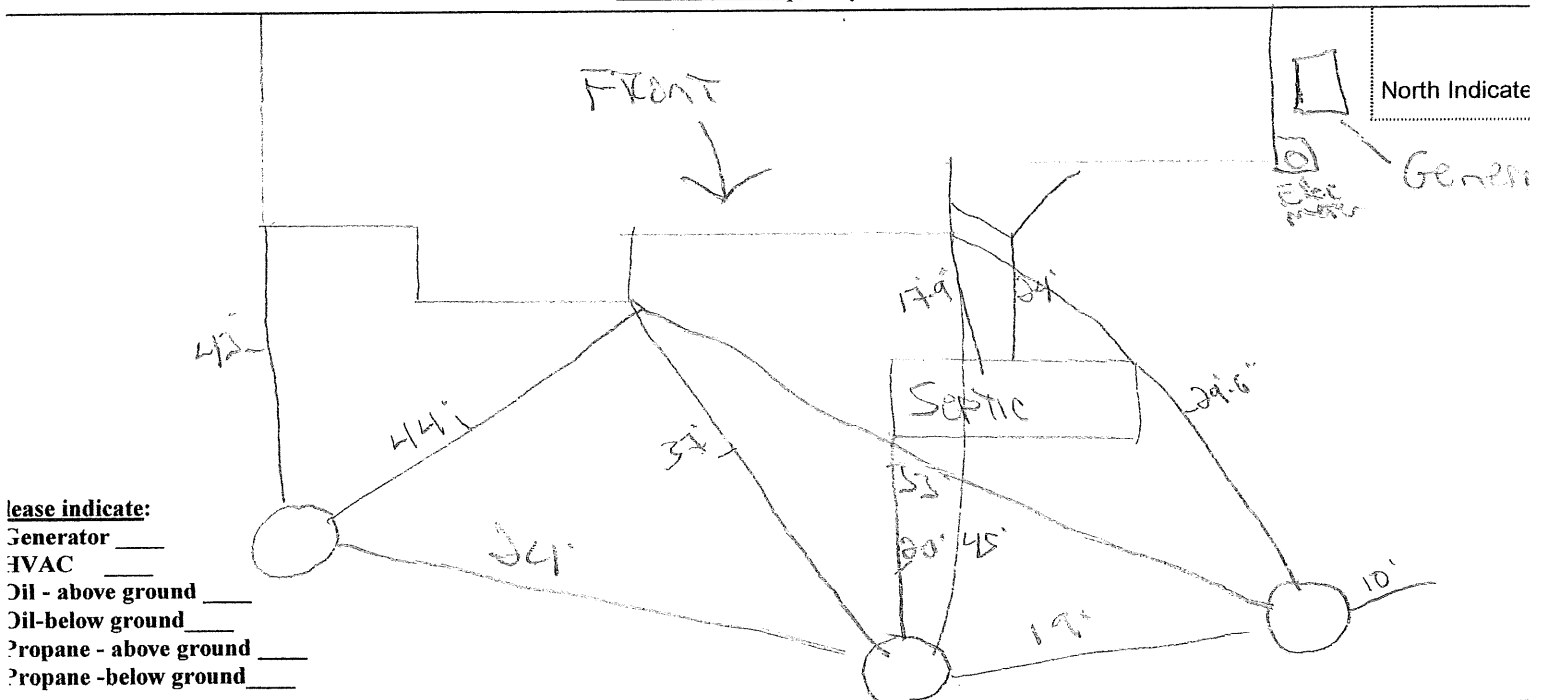

Applicant's Signature: _____

Date: 8-14-2020

Please Print: _____

Ruben Piro

APPLICATION APPROVED ☐

DENIED ☐

OTHER ☐

Signature of Sanitarian: _____

Date: _____

Copy to Building Department

40.00^{22 13}
32

18.30

31


25

25

24

108.70

generator

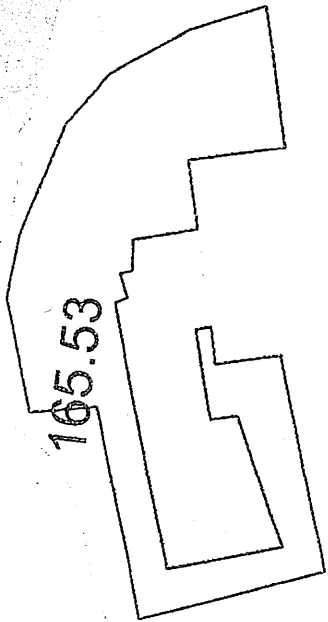

165.53

34

SEPNC

69

0.37 Ac

TC 8308

30

30.5

98.00

80.49

24.49

OTTER TRAIL

22

RECEIVED

AUG 17 2020

WWHD

Bob Baskin

34 Ottertrail

Westport, CT

Load calculation:

- **3500 sq ft X 3Va = 10,500**
- **[3] Small appliance loads =4500va**
- **Sub total 15,000va**
- **1st 3,000va @ 100% = 3,000va**
- **12,000va @ 35% demand factor =4,200va**
- **Sub total= 7,200va**
- **Fixed appliances: fridge, micro, washer, air handler
=3,500va**
- **Fixed appliance demand factor 3,500va X 75% =2,625va**
- **Sub total = 9,825Va**
- **Ac 7,200 Va**
- **Total = 17,025Va/240 volts = 70 amps**

22kw generator = 83 amps @ 100%

83amps X 80%= 67 amps

RECEIVED

AUG 17 2020

1411000000